


- NOTES:**
1. FOR GENERAL NOTES, LEGEND, TABLES, SEE DRAWING F-1-2-1.
 2. CONTRACTOR SHALL RUN ALL WIRING AND CONDUIT AND MAKE ALL CONNECTIONS FOR PUSH MOUNTED STROBE DEVICES MOUNTED ON WALL SURFACES RECESSED IN WALLS BEHIND WALLS.

STROBE CIRCUIT/LOADING TABLE									
STROBE TYPE AND RATING	TYPE	150V	300V	750V	1500V	CURRENT PER CIRCUIT (AMPS)	PER CIRCUIT (FT)	PER CIRCUIT (V)	PER CIRCUIT (A)
STR-A	5	1	3	-	-	1.270	331	-	-
STR-B	4	1	3	-	-	1.190	320	-	-
STR-C	2	2	4	-	-	1.410	280	-	-
STR-D	3	1	2	-	-	0.885	336	-	-
STR-E	8	1	2	-	-	1.285	333	-	-
STR-F	5	3	2	-	-	1.295	340	-	-
GRAND TOTAL						7.295	1940		

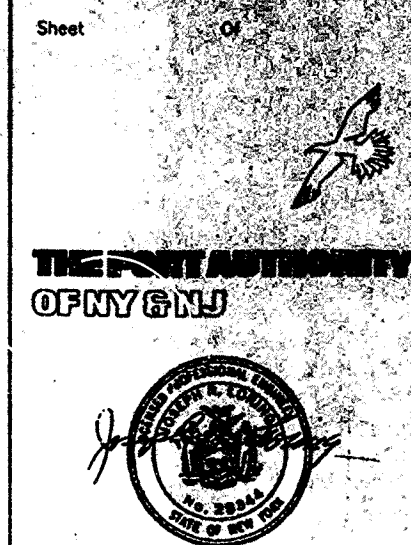

Joseph R. Loring & Associates, Inc.
consulting engineers
One Pennsylvania Plaza
New York, New York 10119-0045
Tel: (212) 563-7400
Fax: (212) 563-7382

SCR Design Organization, Inc.
architects
305 EAST 46 STREET
NEW YORK, N.Y. 10017
TEL: (212) 421-3500

1	6/24/98	AS BID	DC
No.	Date	Revision	Approved

Engineering Department
Design Division
The World Trade Center

Title
**TOWER 1
FLOOR 78
FIRE ALARM
STROBE
INSTALLATION AND
REMOVAL PLAN**

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

F.D. 4565.000
Designed by F.D. JRLA JOB No.
4/27/98 P.E.N. 3/32"=1'-0"
Date Checked by Scale
Contract Number Drawing Number
WTC-857.090 F-1-78-3

